


N:\Standards\2024\Details\DWG\311_Locate Station Placement.dwg, 6/13/2024 10:46:40 AM



NOTES:

1. WHEN CONNECTING TO EXISTING PIPE WITHOUT EXISTING LOCATE WIRE, INSTALL LOCATE STATION AT START OF NEW PIPING.
2. LOCATE STATION WIRE IS PREFERRED TO BE IN THE SAME TRENCH AS SERVICES OR HYDRANT PIPING WHERE POSSIBLE.

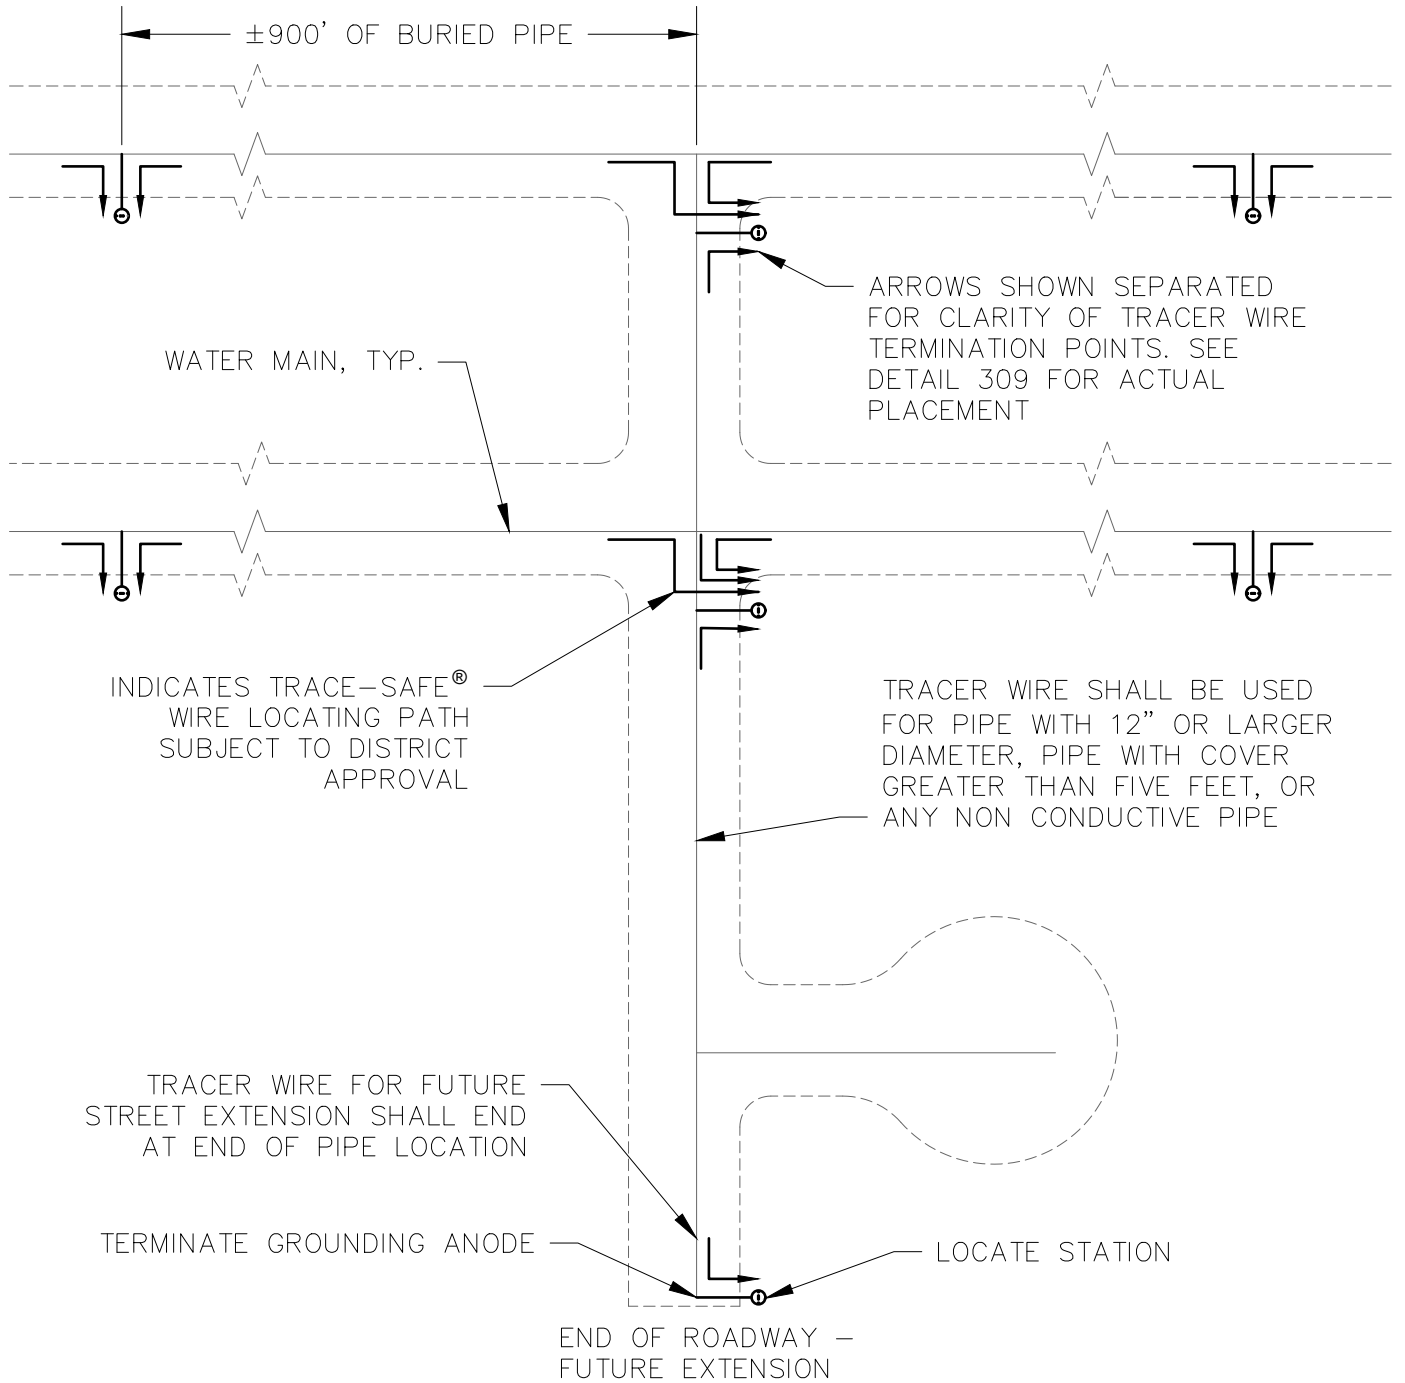

**TUALATIN VALLEY
WATER DISTRICT**

APPROVED BY
PETER BOONE

DRAWING SCALE
NONE

LOCATE STATION PLACEMENT

EFF. DATE 07/01/24

STANDARD DETAIL

311